


UNDERGROUND SERVICE TO FIBER PEDESTAL

NOTES:

1. THE PUD PREFERS THE CUSTOMER CONDUIT STUB UP LOCATION TO BE LOCATED NEXT TO THE UTILITY METER AS SHOWN IN THIS SCHEMATIC. HOWEVER, THE CUSTOMER MAY RUN CONDUIT TO ANY LOCATION OUTSIDE THE HOUSE PROVIDED THE FINAL CABLE LENGTH FROM THE FIBER PEDESTAL TO THE STUB UP LOCATION OUTSIDE OF THE HOUSE TO THE UTILITY METER DOES NOT EXCEED 250 FEET.
2. CUSTOMER SHALL TRENCH FROM PUD PEDESTAL TO HOUSE STUB UP LOCATION. LEAVE LAST 3 FEET OF TRENCH UP TO THE PEDESTAL OPEN FOR INSPECTION.

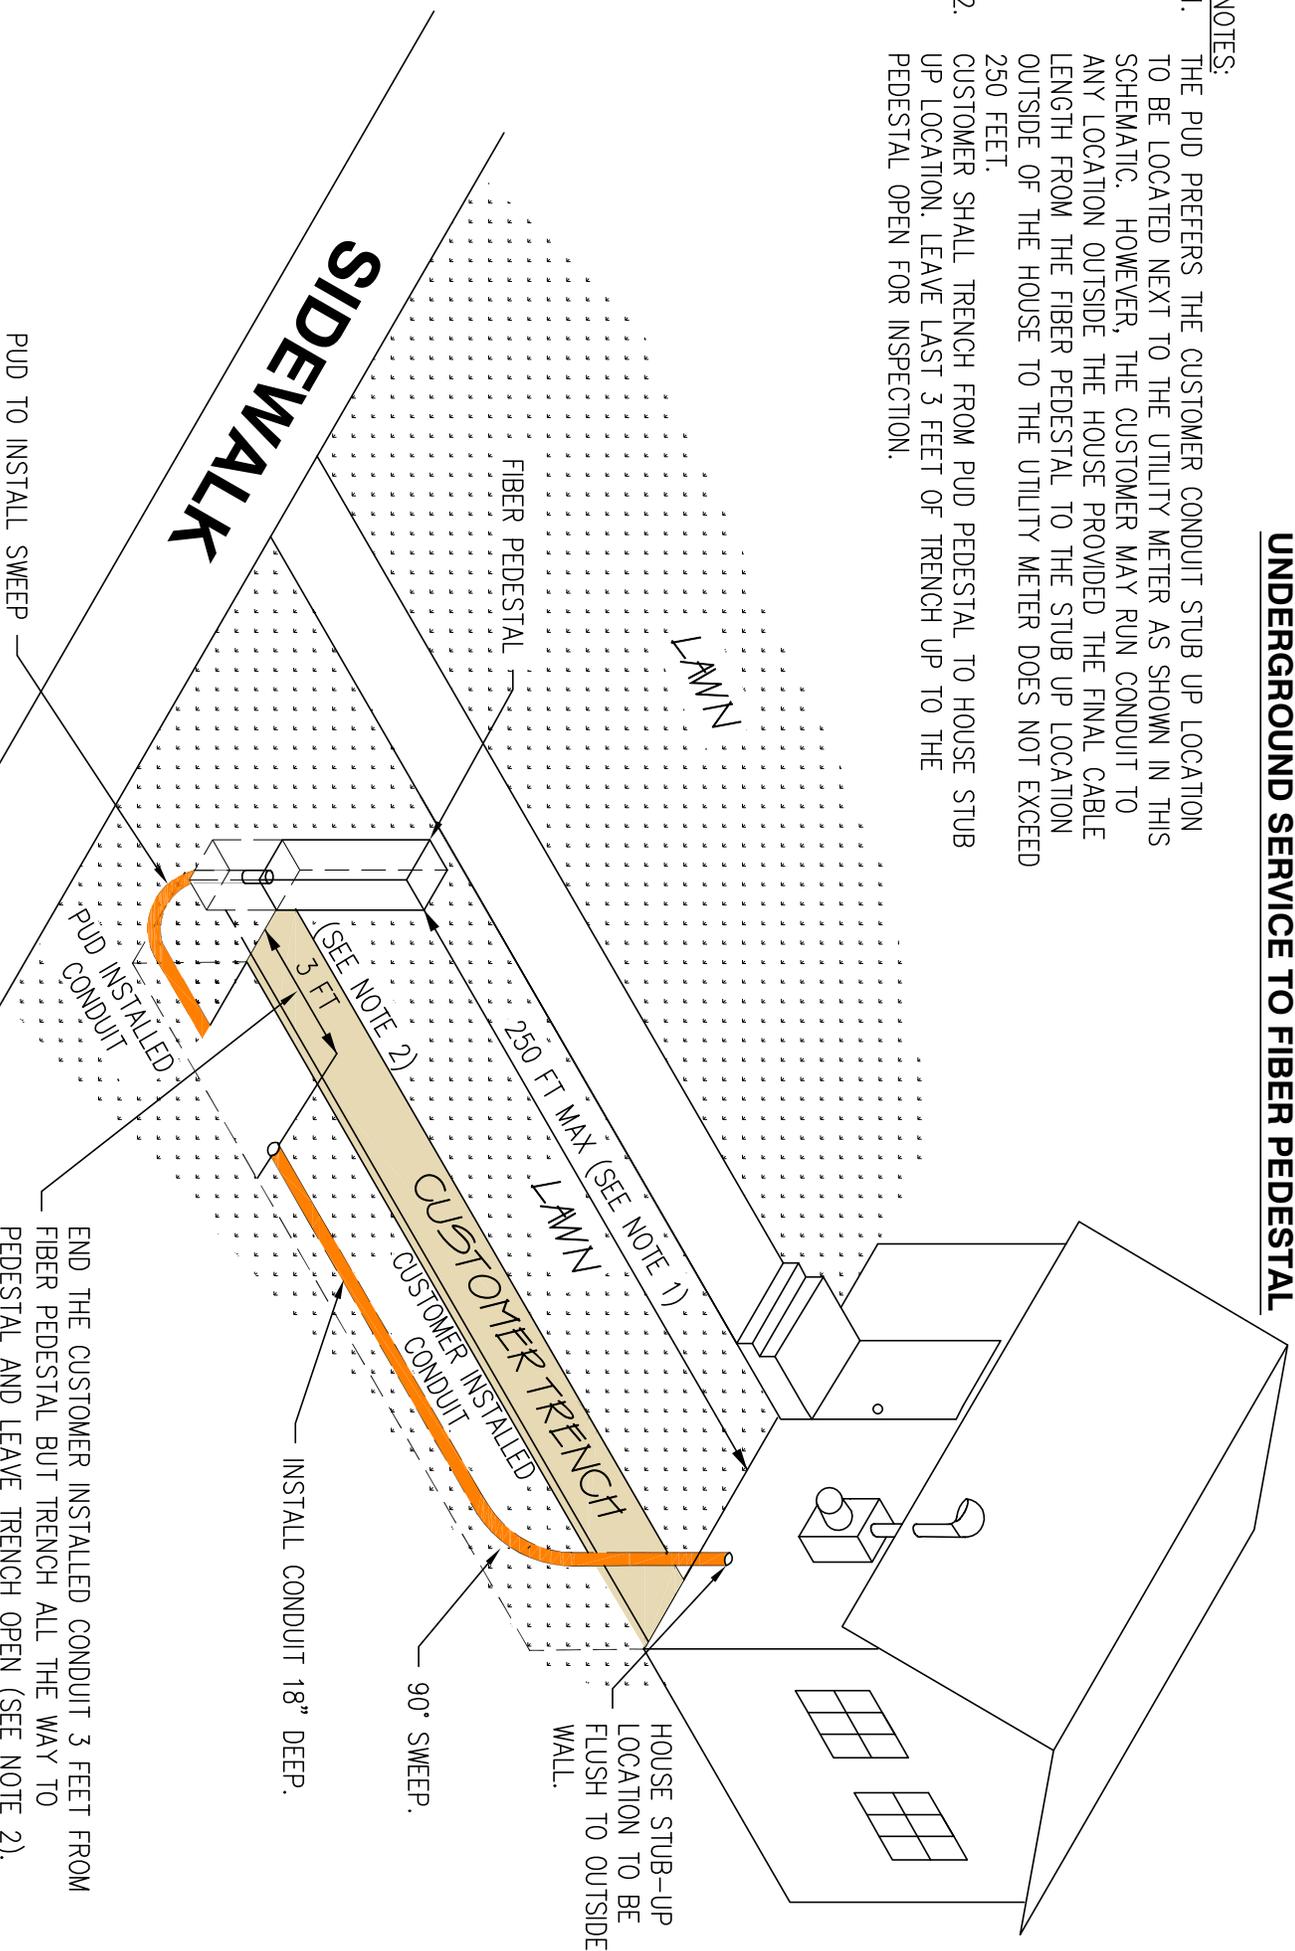

A	Revised 10/05/15	Revision #	Approved By:
----------	------------------	------------	--------------

STANDARD DETAILS

FIBER CONDUIT TO FIBER PEDESTAL LAYOUT

Drawing is NOT to scale

A-03